


NOTES:

1. CONSTRUCTION METHODS AND MATERIALS SHALL CONFORM WITH SECTION 425 OF THE FLORIDA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATION FOR ROAD AND BRIDGE CONSTRUCTION.
2. OPENING AROUND UNDERDRAIN PIPE SHALL BE GROUT-FILLED.
3. MANHOLE COVERS SHALL COMPLY WITH PC No. 1250.
4. WHEN AUTHORIZED BY THE ENGINEER AND AT NO ADDITIONAL EXPENSE TO THE COUNTY, FDOT INDEX No. 200 MANHOLE TYPE P (ALTERNATE A), MAY BE USED IN PLACE OF A COUNTY UNDERDRAIN INSPECTION MANHOLE.
5. EXCEPT AS OTHERWISE NOTED ON THE PLANS, FRAME FOR MANHOLE COVERS SHALL BE FDOT INDEX No. 201, TYPE I.
6. MINIMUM WALL THICKNESS: 4 1/2" FOR PREFAB AND 6" FOR POURED IN PLACE.
7. FOR POURED IN PLACE CONSTRUCTION, DOWELS MAY BE USED IN LIEU OF JOINT KEY AND GROUTING. DOWELS SHALL EXTEND A MINIMUM OF 6" INTO ADJACENT SECTIONS.

JOINT DIMENSIONS

- ① 1" PRIOR TO PLACEMENT OF UPPER SECTION
- ② 1/2" MAXIMUM AFTER FINAL SETTLEMENT OF UPPER SECTION
- ③ 1 1/2" WIDE (4 1/2" WALL)
2" WIDE (6" WALL)

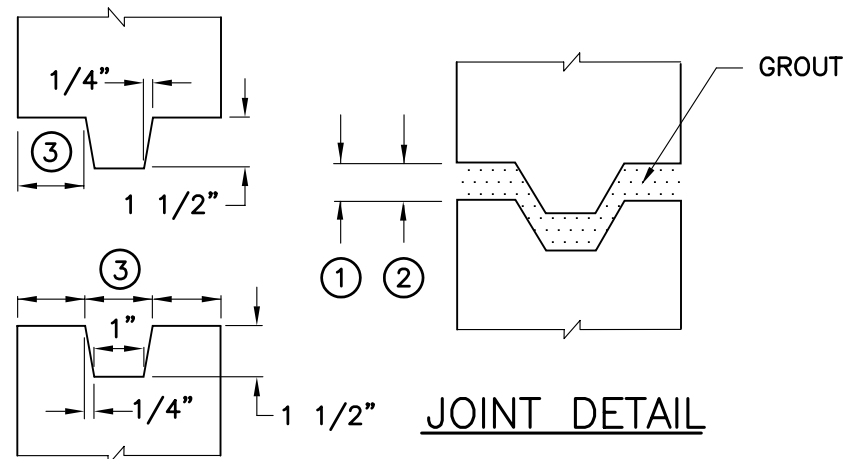

DEPARTMENT OF PUBLIC WORKS PINELLAS COUNTY, FLORIDA			
UNDERDRAIN INSPECTION MANHOLE TYPE 2			
APPROVED BY:	DATE	SHEET	INDEX
_____ DIRECTOR OF PUBLIC WORKS	8/96	1 of 1	1282