

Public Health

In order to ensure that tap water is safe to drink, the EPA prescribes regulations, which limit the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's Safe Drinking Water Hotline at 1-800-426-4791.


Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons, such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbiological contaminants are available from the Safe Drinking Water Hotline (800-426-4791).



Delivering Quality

Pinellas County delivers tap water that is a clean, quality product. Pinellas County Utilities (PCU) proudly reports that the water provided to customers meets or exceeds all Federal and State standards for safe drinking water. All the information contained in this report has been collected and reported in accordance with the rules and regulations of the Florida Department of Environmental Protection (FDEP) and the United States Environmental Protection Agency (USEPA). Each day, county employees work around-the-clock to ensure that the water provided meets or exceeds these standards and expectations for safety, reliability and quality. We hope that you will take a few minutes to review this important information.

To increase public awareness about fundamental drinking water information, the U.S. Environmental Protection Agency requires water suppliers to provide an annual Consumer Confidence Report (on water quality) to each of their customers.

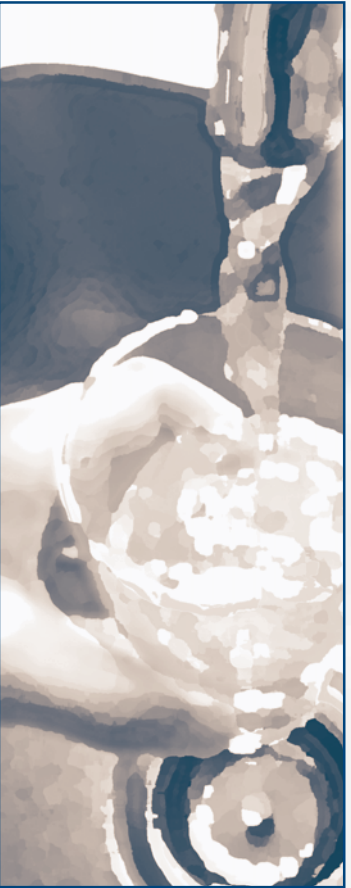

Our Water Sources

Pinellas County Utilities' customers receive potable (drinking) water from sources managed by the regional water supplier, Tampa Bay Water (TBW). This regional water supply is a blend composed of groundwater, treated surface water and desalinated seawater. Thirteen regional wellfields pumping water from the Floridan Aquifer are the primary sources for the regional groundwater supply. The Alafia River, Hillsborough River, C. W. Bill Young Regional Reservoir, and the Tampa Bypass Canal are the primary sources for the regional treated surface water supply. Hillsborough Bay is the primary source of seawater for the regional desalinated supply. From blends of these water sources as well as the Eldridge-Wilde Wellfield, potable water is transferred to pumping stations where it undergoes additional minor processes before being pumped to homes and businesses through 1,996 miles of pipe in the PCU distribution system.

The blended water provided by Tampa Bay Water is treated with a polyphosphate inhibitor to control corrosion then fluoridated for dental health purposes. The groundwater acquired from the Eldridge-Wilde Wellfield undergoes water quality enhancements that are comprised of five steps. First, the water goes through a hydrogen sulfide removal process. Hydrogen sulfide is a natural element that has a displeasing odor. A polyphosphate inhibitor is then added to control corrosion in the distribution system and home plumbing. As the inhibitor is added, fluoride is also added for dental health purposes. Next, a chemical disinfectant, chloramines, is added to the water to guard against bacteria. Lastly, the pH (acid-alkali) is adjusted and stabilized using sodium hydroxide.



TBW WTP, Tampa Bay Water Water Treatment Plant

Your Local Government

The Pinellas County Board of County Commissioners meets twice a month, usually, but not always, on the first and third Tuesdays. The earlier meeting in the month begins at 9:30 a.m. Meetings in the latter part of the month are actually held in two parts. Agenda items are discussed with the Board at 3:00 p.m., after which there is a break and the Board reconvenes at 6:30 p.m. The public is invited to attend these meetings held in the 5th floor Assembly Room of the Pinellas County Courthouse located at 315 Court Street, Clearwater, Florida 33756. Meetings are televised live (and close captioned) on PCC-TV, the Pinellas County Connection Television cable channel, and repeated during the week.

The meeting agendas are published on the County's Web site at www.pinellascounty.org. For more information, call 727-464-3485.

Tampa Bay Water's Board of Directors meetings occur at 9:00 a.m. on the third Monday of every other (even) month at 2575 Enterprise Road, Clearwater, Florida 33763. To view the agenda, visit www.tampabaywater.org or call (727) 796-2355.



Source Water Assessment

In 2004 the Department of Environmental Protection performed a Source Water Assessment for Tampa Bay Water (TBW). The assessment results are available on the FDEP Source Water Assessment and Protection Program Web site at www.dep.state.fl.us/swapp or they can be obtained from Tampa Bay Water, 2575 Enterprise Rd., Clearwater, FL 33763, phone 727-796-2355.

In 2004 the Department of Environmental Protection performed a Source Water Assessment for Tampa Bay Water. The assessment was conducted to provide information about any potential sources of contamination in the vicinity of the TBW surface water intakes. The surface water system is considered to be at high risk because of the many potential sources of contamination present in the assessment area. The assessment results are available on the FDEP Source Water Assessment and Protection Program Web site at www.dep.state.fl.us/swapp or they can be obtained from Tampa Bay Water, 2575 Enterprise Rd., Clearwater, FL 33763, phone 727-796-2355.



What Does It All Mean?

The following text is written verbatim in accordance with the Florida Department of Environmental Protection CCR Template instructions, January 8, 2007.

Pinellas County Utilities and Tampa Bay Water routinely monitor for contaminants in your drinking water according to Federal and State laws, rules, and regulations. Except where indicated otherwise, this report is based on the results of our monitoring for the period of **January 1 to December 31, 2007**. Data obtained before January 1, 2007, and presented in this report are from the most recent testing done in accordance with the laws, rules, and regulations. As authorized and approved by the USEPA, the State has reduced monitoring requirements for certain contaminants to less often than once per year because the concentrations of these contaminants are not expected to vary significantly from year to year. Some of our data, though representative, is more than one year old. The USEPA requires monitoring of over 80 drinking water contaminants. Those contaminants listed in the accompanying tables are the only contaminants detected in your drinking water.

If you would like to request a copy of the Tampa Bay Water 2007 CCR, please contact them at 727-796-2355.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can

pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- (A) Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- (B) Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- (C) Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- (D) Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems.
- (E) Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.

Terms to Know

In the accompanying tables, you may find unfamiliar terms and abbreviations. To help you better understand these terms, we've provided the following definitions:

Action Level, (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Chloramine, (NH₂Cl): A compound made by chemically combining chlorine with ammonia. Monochloramine, one of three possible combinations, is the desired chloramine form for disinfection of potable water.

Chlorine, (Cl): An element that readily combines with other elements in water to disinfect potable water.

Data Qualifier Code, (I): Indicates the reported value is between the laboratory detection limit and the laboratory quantitation limit.

Haloacetic Acids, (HAAs): A group of disinfection by-products formed as a result of the chemical disinfection of water.

Initial Distribution System Evaluation, (IDSE): An important part of the Stage 2 Disinfection Byproducts Rule (DBPR). The IDSE is a one-time study conducted by water systems to identify distribution system locations with high concentrations of trihalomethanes (THMs) and haloacetic acids (HAAs). Water systems will use results from the IDSE, in conjunction with their Stage 1 DBPR compliance monitoring data, to select compliance monitoring locations for the Stage 2 DBPR.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Millirem per year, (mrem/yr): A measure of radiation absorbed by the body.

Nephelometric Turbidity Unit, (NTU): A measure of the clarity of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

No Goal Established, (NGE): No maximum contaminant level goal (MCLG) established for this contaminant.

Not Applicable, (NA): Not applicable to this contaminant.

Not Detected, (ND): Not detected; indicates that the substance was not found by laboratory analysis.

Parts per billion, (ppb), or Micrograms per liter, (ug/L): One part by weight of analyte to 1 billion parts by weight of the water sample.

Parts per million, (ppm), or Milligrams per liter, (mg/L): One part by weight of analyte to 1 million parts by weight of the water sample.

Parts per trillion, (ppt) or Nanograms per liter, (nanograms/L): One part by weight of analyte to 1 trillion parts by weight of the water sample.

Parts per quadrillion, (ppq) or Picograms per liter, (picograms/L): One part by weight of analyte to 1 quadrillion parts by weight of the water sample.

Picocurie per liter, (pCi/L): A measure of the radioactivity in water.

Primary Contaminants: Health-related standards established by federal and state agencies.

Secondary Contaminants: Constituents which affect taste, odor, and appearance (color). These are not considered a health concern.

Treatment Technique, (TT): A required process intended to reduce the level of a contaminant in drinking water.

Total Trihalomethanes, (TTHMs): A group of disinfection by-products formed as a result of the chemical disinfection of water.

Important Notice

As a multi-family or commercial customer you too have the responsibility to let your tenants/clients know what's in the drinking water provided to your facility. To meet our mutual obligations, we are requesting you display the enclosed report in your common area or on a visible bulletin board. If you prefer, call us at (727) 464-4000 and we'll be pleased to send additional copies for distribution free of charge.

For Your Reference		
	Hardness	Levels of Pinellas County water ranges between 130-211 milligrams per liter (mg/L) or parts per million (ppm). This is equivalent to 7-12.8 grains per gallon (gpg).
	pH	7.6-7.9 standard units
	Chloramines	2.90-3.78 ppm

Questions or Comments

At Pinellas County Utilities, we value our customers and work hard to ensure your satisfaction. If you have questions or comments about this report or other issues, please call us: Customer Service: (727) 464-4000 Utilities Lab: (727) 582-2302 Water Conservation: (727) 464-3896 Emergencies: (727) 464-4000. You may also visit www.pinellascounty.org/utilities.

2007 Water Quality Analysis

Pinellas County Utilities (PCU)						
Microbiological Contaminants						
Contaminant and Unit of Measurement	MCLG	MCL	Dates of Sampling (mo./yr.)	MCL Violation Y/N	Highest Monthly Percentage	Likely Source of Contamination
Total Coliform Bacteria	0	*	1/07-12/07	No	2.6%	Naturally present in the environment
Total Coliform Bacteria: Highest Monthly Percentage is the highest monthly percentage of positive samples for systems collecting at least 40 samples per month. *For systems collecting at least 40 samples per month: presence of coliform bacteria in 5% or more of monthly samples.						

Contaminant and Unit of Measurement	MCLG	MCL	Dates of Sampling (mo./yr.)	MCL Violation Y/N	Total No. of Positive Samples for the Year	Likely Source of Contamination
Fecal coliform and E. coli	0	0*	1/07-12/07	No	1 ++	Human and animal fecal waste
* MCL for fecal coliforms is 0 for acute violations only where a fecal or E. Coli positive is followed by a repeat sample positive for fecal, E. Coli or total coliform. ++ One non-acute sample for E. Coli bacteria did not violate the MCL for the Total Coliform Rule because repeat samples were absent of any coliform contamination. Non-acute E. Coli positive results were included within the monthly total coliform percentage.						
** Results in the Level Detected column for radiological contaminants, inorganic contaminants, and volatile organic contaminants are the highest average at any of the sampling points or the highest detected level at any sampling point, depending on the sampling frequency.						

Radiological Contaminants							
Contaminant and Unit of Measurement	MCLG	MCL	Dates of Sampling (mo./yr.)	MCL Violation Y/N	Level Detected	Range of Results	Likely Source of Contamination
Alpha emitters (pCi/L)	0	15	3/05	No	2.6	ND - 2.6	Erosion of natural deposits
Radium 226 + 228 or combined radium (pCi/L)	0	5	3/05	No	ND - 1.1	ND - 1.1	Erosion of natural deposits
Uranium (ug/L)	0	30	3/05	No	3.9*	NA	Erosion of natural deposits
* Uranium is a calculated result.							

Inorganic Contaminants							
Contaminant and Unit of Measurement	MCLG	MCL	Dates of Sampling (mo./yr.)	MCL Violation Y/N	Level Detected	Range of Results	Likely Source of Contamination
Arsenic (ppb)	NA	10	3/07	No	0.3 I	0.2 I - 0.3 I	Erosion of natural deposits; runoff from orchards; runoff from glass and electronics production wastes
Barium (ppm)	2	2	3/07	No	0.0194	0.0133 - 0.0194	Discharge of drilling wastes; discharge from metal refineries; erosion of natural deposits
Chromium (ppb)	100	100	3/07	No	0.5	0.3 I - 0.5	Discharge from steel and pulp mills; erosion of natural deposits
Cyanide (ppb)	200	200	3/07	No	9.7 I	9.1 I - 9.7 I	Discharge from steel/metal factories; discharge from plastic and fertilizer factories
Fluoride (ppm)	4	4.0	3/07	No	0.72	0.52 - 0.72	Water additive which promotes strong teeth when at optimum levels between 0.7 and 1.3 ppm. Discharge from fertilizer and aluminum factories; erosion of natural deposits.
Lead (point of entry) (ppb)	NA	15	3/07	No	0.1 I	0.1 I	Residue from man-made pollution such as auto emissions and paint; lead pipe, casing, and solder
Nickel (ppb)	NA	100	3/07	No	0.8	0.3 I - 0.8	Pollution from mining and refining operations. Natural occurrence in soil
Nitrate (as Nitrogen) (ppm)	10	10	4/07	No	0.03 I	ND - 0.03 I	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits
Nitrite (as Nitrogen) (ppm)	1	1	4/07	No	0.02 I	ND - 0.02 I	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits
Sodium (ppm)	NA	160	3/07	No	20.8	9.5 - 20.8	Salt water intrusion, leaching from soil

Volatile Organic Contaminants							
Dichloromethane (ppb)	0	5	2/06	No	0.38 I	0.35 I - 0.38 I	Discharge from pharmaceutical and chemical factories

Total Trihalomethanes (TTHMs) and Stage 1 Disinfectant/Disinfection By-Product (D/DBP) Parameters							
For chlorine, the level detected is the the highest running annual average (RAA), computed quarterly, of monthly averages of all samples collected. For haloacetic acids or TTHM, the level detected is the highest RAA, computed quarterly, of quarterly averages of all samples collected if the system is monitoring quarterly or is the average of all samples taken during the year if the system monitors less frequently than quarterly. Range of Results is the range of individual sample results (lowest to highest) for all monitoring locations, including Initial Distribution System Evaluation (IDSE) results as well as Stage 1 compliance results.							
Contaminant and Unit of Measurement	MCLG or MRDLG	MCL or MRDL	Dates of Sampling (mo./yr.)	MCL Violation Y/N	Level Detected	Range of Results	Likely Source of Contamination
Chlorine (ppm)	MRDLG=4	MRDL=4.0	1/07-12/07	No	3.30	3.23 - 3.30	Water additive used to control microbes
Haloacetic Acids (five) (HAA5) (ppb)	NA	MCL=60	1/07, 4/07, 8/07, 10/07	No	20	3.9 - 42.7	By-product of drinking water disinfection
TTHM [Total trihalomethanes] (ppb)	NA	MCL=80	1/07, 4/07, 8/07, 10/07	No	35	16.8 - 77.4	By-product of drinking water disinfection

Lead and Copper (Tap Water)							
Contaminant and Unit of Measurement	MCLG	AL (Action Level)	Dates of Sampling (mo./yr.)	AL Violation Y/N	90th Percentile Result	No. of Sampling Sites Exceeding the AL	Likely Source of Contamination
Copper (tap water) (ppm)	1.3	1.3	6/07-8/07	No	0.593	0	Corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives
Lead (tap water) (ppb)	0	15	6/07-8/07	No	2.3	0	Corrosion of household plumbing systems; erosion of natural deposits

			Tampa Bay Water (TBW)				
Contaminants							
Contaminant and Unit of Measurement	MCLG	MCL	Dates of Sampling (mo./yr.)	MCL Violation Y/N	Level Detected	Range of Results	Likely Source of Contamination
Beta/photon emitters (mrem/yr)	0	4	8/06	No	2.2*	ND - 2.2	Decay of natural and man-made deposits
Bromate (ppb)	0	10	1/07-12/07	No	3.95	ND - 6.89	By-product of drinking water disinfection
* Beta results reported in nCi/L							

Contaminant and Unit of Measurement	MRDLG	MRDL (at the entrance to the distribution system)	Dates of Sampling (mo./yr.)	Acute Violation Y/N	Non-Acute Violation Y/N	Level Detected	Likely Source of Contamination
Chlorine Dioxide (ppb)	800	800	4/07	No	No	373	Water additive used to control microbes
For chlorine dioxide, the level detected is the highest single daily sample collected at the entrance to the distribution system.							

Contaminant and Unit of Measurement	MCLG	MCL	Dates of Sampling (mo./yr.)	MCL Violation Y/N	Highest Single Measure	Lowest Monthly % of Samples Meeting Regulatory Limits	Likely Source of Contamination
Turbidity (NTU)	TT	NA	9/07	No	0.68	100	Soil runoff
NOTE: The result in the lowest monthly percentage column is the lowest monthly percentage of samples reported in the Monthly Operating Report meeting the required turbidity limits.							
Contaminant and Unit of Measurement	MCLG	MCL	Dates of Sampling (mo./yr.)	TT Violation Y/N	Lowest Annual Avg Monthly Removal Ratio	Range of Monthly Removal Ratios	Likely Source of Contamination
Total organic carbon (ppm)	NA	TT	1/07-12/07	No	1.3	1.3 - 2.3	Naturally present in the environment

The monthly TOC removal ratio is the ratio between the actual TOC removal and the required TOC removal. Prepared by Pinellas County Utilities, March 2008, with reference to CCR data provided by Tampa Bay Water